



1 FIRST FLOOR THREE STORY UNIT WATER & GAS PLAN  
1/4" = 1'-0"

P.C. TO FIELD VERIFY LOCATION OF GAS METER  
GAS METER, REGULATOR AND UNDERGROUND SERVICE BY LOCAL GAS COMPANY. 100 MBH AT 2PSIG DELIVERY PRESSURE. 100 FT TO MOST REMOTE FIXTURE.

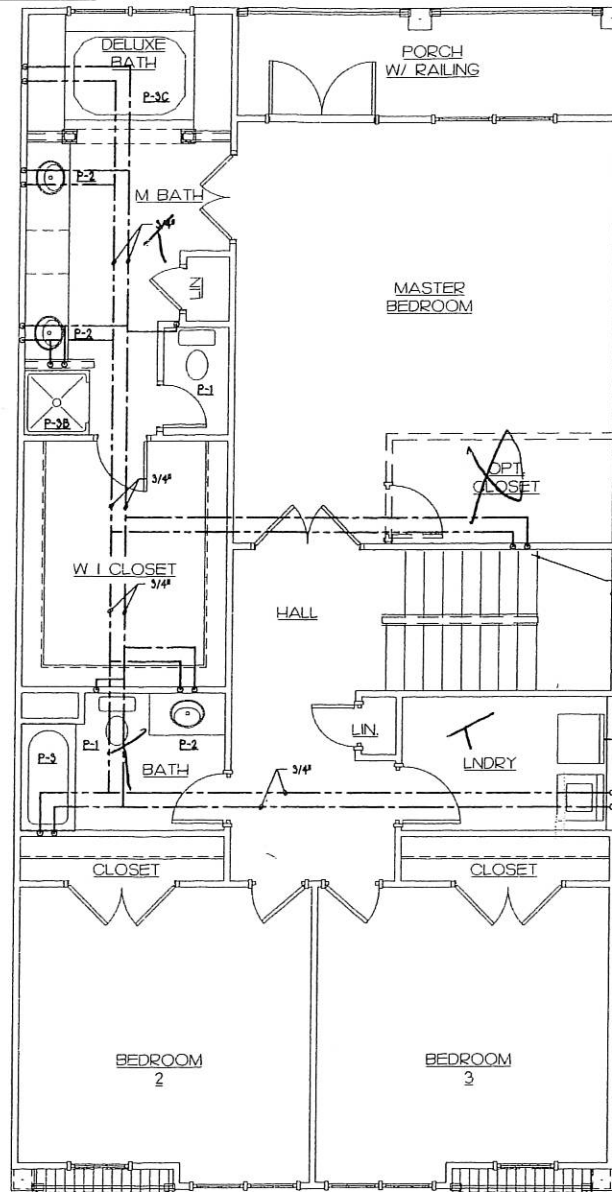

2 SECOND FLOOR THREE STORY UNIT WATER & GAS PLAN  
1/4" = 1'-0"

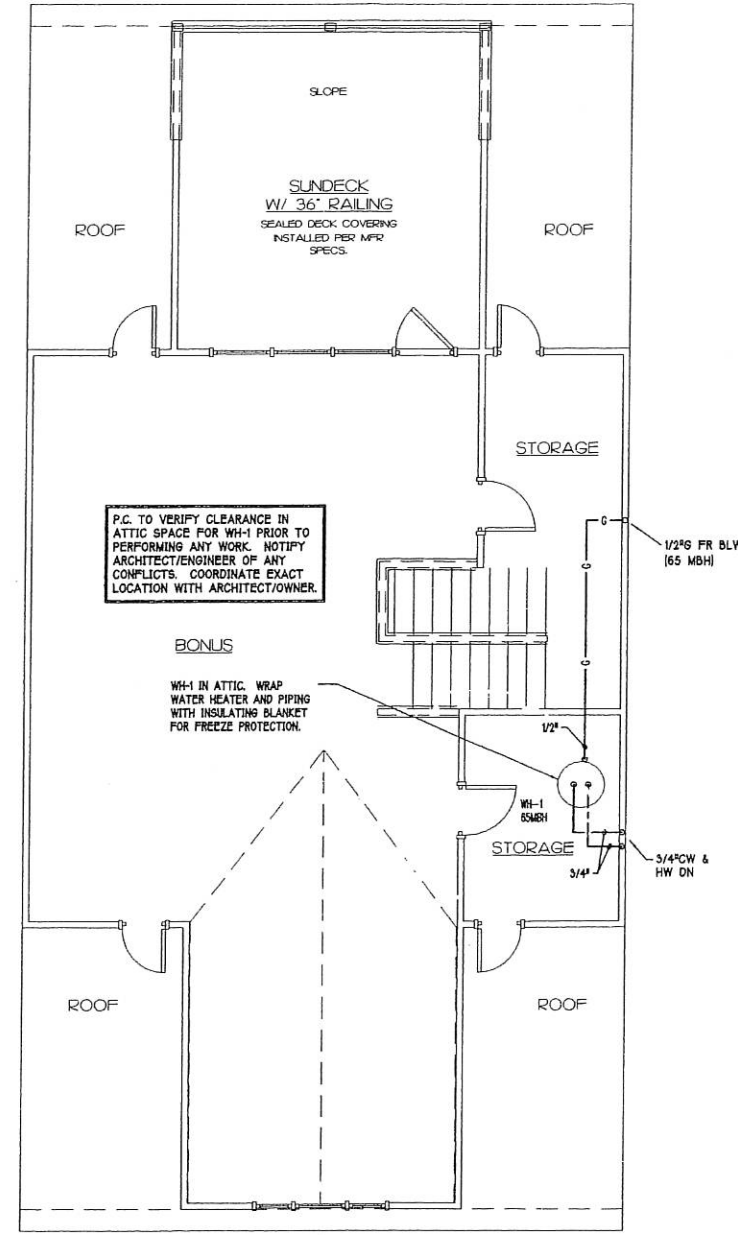

3 THIRD FLOOR THREE STORY UNIT WATER & GAS PLAN  
1/4" = 1'-0"

PLUMBING NOTES FOR UNIT PLANS:

- SEE SHEET P8 FOR FIXTURE SCHEDULE & CONNECTION SIZES.
- ALL WATER SUPPLY LINES IN AN EXTERIOR WALL SHALL BE RUN ON INTERIOR SIDE OF WALL INSULATION.
- PROVIDE SHUT-OFF VALVE IN EACH UNIT IN AN ACCESSIBLE LOCATION THAT CONTROLS ALL WATER SUPPLY TO THAT UNIT.
- ALL WATER PIPING IS 1/2" UNLESS OTHERWISE NOTED.
- PROVIDE ALL REQUIRED PLUMBING CONNECTIONS FOR DISHWASHER AND DISPOSAL IN EACH UNIT PER MFR RECOMMENDATIONS.
- PROVIDE CLEANOUT AT THE BASE OF ALL WASTE STACKS.

GAS LOAD TABLE (3 STORY UNIT)	
LOW PRESSURE PRESSURE DROP: 0.5 IN.W.C. STEEL (SCHD. 40) LENGTH: 100 FT FITTINGS FACTOR: 12 EQUIVALENT TOTAL LENGTH: 120 FT. CAPACITY OF PIPES IN MBH	
1/2"	45
3/4"	84
1"	177
1-1/4"	363
1-1/2"	544
2"	1047
2-1/2"	1668
HIGH PRESSURE ATMOSPHERIC PRESSURE: 14.6954 PSIA PS: 2 PSIG PL: 1 PSIG STEEL (SCHD. 40) LENGTH: 100 FT FITTINGS FACTOR: 12 EQUIVALENT TOTAL LENGTH: 120 FT. CAPACITY OF PIPES IN MBH	
1/2"	414
3/4"	867
1"	1632
1-1/4"	3351

NOTE:  
GAS PIPING IS SIZED FOR 2PSI CONTRACTOR SHALL PROVIDE AN ALTERNATE BID FOR LOW PRESSURE PIPING.  
CONTRACTOR SHALL VERIFY THE AVAILABILITY OF 2PSI SERVICE BEFORE ANY WORK HAS BEGUN AND NOTIFY ARCHITECT IN WRITING OF AVAILABLE SERVICE.

BUM-40

**URBAN**  
**Architectural**  
GROUP P.A.  
1342 Mann Drive, Suite 200  
Matthew North Carolina 28105  
www.urbanarchitecturalgroup.com  
P: 704.841.1899 F: 704.841.8440

© 2004 URBAN ARCHITECTURAL GROUP P.A.  
**VP**  
VRETOS PAPPAS  
Consulting Engineers, PA  
101 N. McDowell St.  
Suite 120  
Charlotte, NC 28204  
P: 704.372.7755  
F: 704.372.7799  
www.vpc.com

Professional Engineer Seal  
No. 22725  
VRETOS PAPPAS  
CONSULTING ENGINEERS, PA  
No. 02750  
STATE OF NORTH CAROLINA

LAKE SHORE  
TOWN  
HOMES

Tega Cay,  
South Carolina

DATE DRAWN:	06/09/05
PROJECT NO.:	2530
ISSUED FOR:	Permit & Construction:

P4

TYPICAL 3 STORY UNIT  
WATER & GAS PLANS