



1 FIRST FLOOR FOUR STORY UNIT SANITARY PLAN
1/4" = 1'-0"

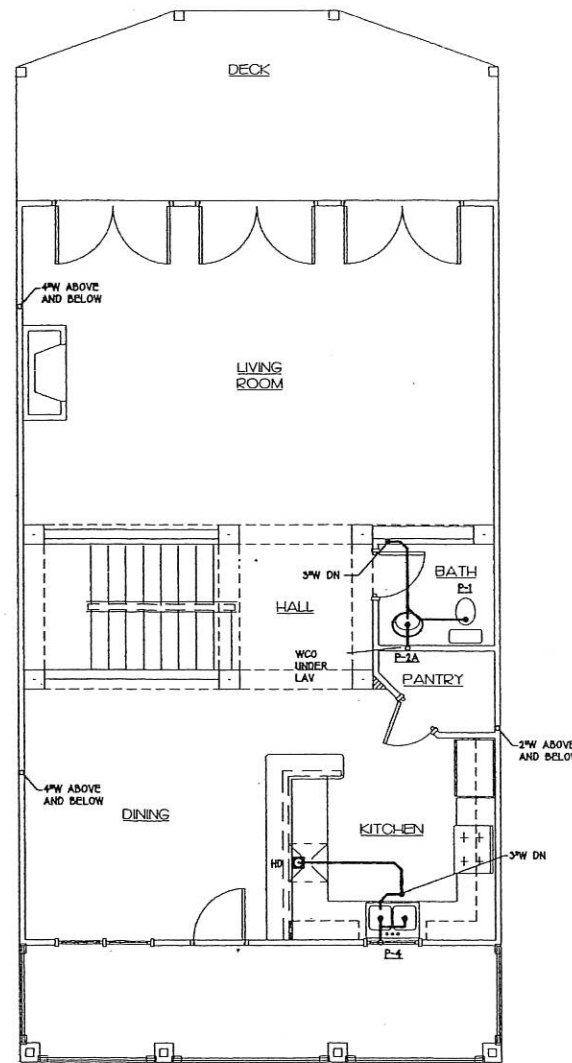

2 SECOND FLOOR FOUR STORY UNIT SANITARY PLAN
1/4" = 1'-0"

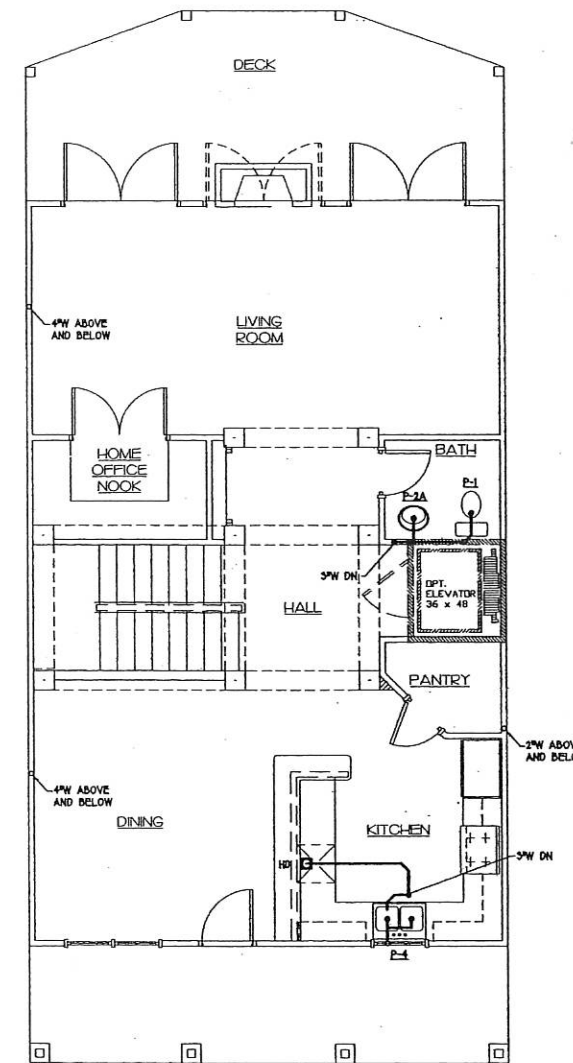

3 SECOND FLOOR FOUR STORY UNIT (ALT) SANITARY PLAN
1/4" = 1'-0"

PLUMBING NOTES FOR UNIT PLANS:

- SEE SHEET P5 FOR FIXTURE SCHEDULE & CONNECTION SIZES.
- ALL WATER SUPPLY LINES IN AN EXTERIOR WALL SHALL BE RUN ON INTERIOR SIDE OF WALL INSULATION.
- PROVIDE SHUT-OFF VALVE IN EACH UNIT IN AN ACCESSIBLE LOCATION THAT CONTROLS ALL WATER SUPPLY TO THAT UNIT.
- ALL WATER PIPING IS 1/2" UNLESS OTHERWISE NOTED.
- PROVIDE ALL REQUIRED PLUMBING CONNECTIONS FOR DISHWASHER AND DISPOSAL IN EACH UNIT PER MFR RECOMMENDATIONS.
- PROVIDE CLEANOUT AT THE BASE OF ALL WASTE STACKS.

**LAKE SHORE
TOWN
HOMES**

Tego Cay,
South Carolina

DATE DRAWN	06/09/05
PROJECT NO.	2530
ISSUED FOR	Permit & Construction